

## Evaluation Report "Englert® Series 2000" Metal Roof Assembly

### Manufacturer:

**Englert, Inc.**

1200 Amboy Avenue  
Perth Amboy, NJ 08862  
(732) 826-8614

*for*

### Florida Product Approval

**# FL 11751.5 R5**

### Florida Building Code 6th Edition (2017)

**Method: 1 - D**

**Category: Roofing**

**Sub - Category: Metal Roofing**

**Product:** "Series 2000" Roof Panel

**Material:** Aluminum

**Panel Thickness:** 0.032"

**Panel Width:** 18"

**Panel Seam:** Snap-Lock

**Support:** Steel Deck


### Prepared by:

James L. Buckner, P.E., SECB  
Florida Professional Engineer # 31242  
Florida Evaluation ANE ID: 1916  
Project Manager: Diana Galloway  
Report No. 15-126-2000-A3S-ER  
(Revises 15-126-S2000-A4W-ER, FL11751.5 R3-R4)  
Date: 9 / 16 / 17

### Contents:

Evaluation Report                      Pages 1 – 9

Facsimile of digital copy signed by  
James L. Buckner, P.E.  
Electronically signed and sealed documents shall  
comply with the provisions of FAC Rule 61G15-23.

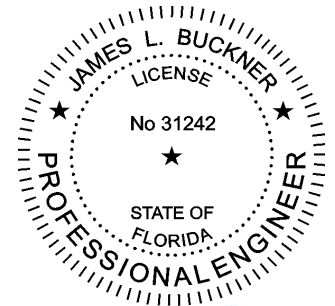

A handwritten signature in blue ink, appearing to read "James L. Buckner".

2017.10.11 13:33:36 -04'00'

<b>Manufacturer:</b>	<b>Englert, Inc.</b> 1200 Amboy Avenue Perth Amboy, NJ 08862 (732) 826-8614 <a href="http://www.englertinc.com/">http://www.englertinc.com/</a>
<b>Product Name:</b>	<b>"Series 2000"</b>
<b>Product Category:</b>	Roofing
<b>Product Sub-Category</b>	Metal Roofing
<b>Compliance Method:</b>	State Product Approval Rule 61G20-3.005 (1) (d)
<b>Product/System Description:</b>	"Series 2000" Roof Panel 0.032" Aluminum Snap-Lock roof panel mechanically attached to Steel Deck with fixed panel clips & screws.
<b>Product Assembly as Evaluated:</b>	Refer to Page 4 of this report for product assembly components/materials & standards: <ol style="list-style-type: none"><li>1. Roof Panel</li><li>2. Panel Clip</li><li>3. Bearing Plate</li><li>4. Fasteners</li><li>5. Adhesive</li><li>6. Underlayment</li><li>7. Insulation (Optional)</li></ol>
<b>Support:</b>	<b>Type:</b> Steel Deck (Design of support and its attachment to support framing is outside the scope of this evaluation.) <b>Description:</b> <ul style="list-style-type: none"><li>• Thickness: 22 gauge minimum</li><li>• Yield strength: 40 ksi minimum</li></ul>
<b>Slope:</b>	Minimum slope shall be: 3 : 12 or greater In compliance with FBC Chapter 15 based on the type of roof covering, applicable code sections and in accordance with manufacturer's recommendations.
<b>Performance:</b>	Wind Uplift Resistance: <ul style="list-style-type: none"><li>• Design Uplift Pressure: <b>See Table "A"</b> (Refer to "Table A" attachment details herein)</li></ul>

**Performance**

**Standards:**

The product described herein has demonstrated compliance with:

- UL580-06 – *Test for Uplift Resistance of Roof Assemblies*
- UL 1897-12 – *Uplift test for roof covering systems*
- TAS 125-03 – *Standard Requirements for Metal Roofing Systems*

**Standards Equivalency:**

The UL 580-94 & UL 1897-98 standard version used to test the evaluated product assembly is equivalent with the prescribed standards in UL 580-06 & UL 1897-12 adopted by the Florida Building Code 6th Edition (2017).

**Code Compliance:**

The product(s) described herein have demonstrated compliance with the performance standards listed above as referenced in the current Florida Building Code.

**Evaluation Report  
Scope:**

This building envelope product is evaluated for compliance with the structural requirements of the Florida Building Code, per the scope sections of Florida Product Approval Rule 61G20-3.001.

**Limitations and  
Conditions of Use:**

- Scope of “Limitations and Conditions of Use” for this evaluation:  
This evaluation report for “Optional Statewide Approval” contains technical documentation, specifications and installation method(s) which include “Limitations and Conditions of Use” throughout the report in accordance with Rule 9N-3.005. Per Rule 9N-3.004, the Florida Building Commission is the authority to approve products under “Optional Statewide Approval”.
- Option for application outside “Limitations and Conditions of Use”  
Rule 9N-3.005(1)(e) allows engineering analysis for “project specific approval by the local authorities having jurisdiction in accordance with the alternate methods and materials authorized in the Code”. Any modification of the product as evaluated in this report and approved by the Florida Building Commission is outside the scope of this evaluation and will be the responsibility of others.
- Design of support system is outside the scope of this report.
- Fire Classification is outside the scope of Rule 61G20-3, and is therefore not included in this evaluation.
- This evaluation report does not evaluate the use of this product for use in the High Velocity Hurricane Zone code section. (Dade & Broward Counties)

**Quality Assurance:**

The manufacturer has demonstrated compliance of roof panel products in accordance with the Florida Building Code and Rule 61G20-3.005 (3) for manufacturing under a quality assurance program audited by an approved quality assurance entity through Keystone Certifications, Inc. (FBC Organization ID# QUA 1824).

**Components/Materials  
(by Manufacturer):**

**Roof Panel:**  
Material: Englert Series 2000 Aluminum  
Thickness: 0.032" (min.)  
Panel Widths: 18" (max.) Coverage  
Rib Height: 1-3/4"  
Alloy Type: 3105 H14  
Corrosion Resistance: Per FBC Section 1507.4.3

**Roof Panel Clips:**

Product Name: Englert "Series 2000 Clip"  
Englert Part #: 05076B  
Type: One-piece, fixed clip  
Material: Galvanized Steel  
Thickness: 18 gauge  
Yield Strength: 40 ksi min.  
Dimensions: 1-3/4" (tall) x 3-1/2" (long) x 2-1/2" (wide)  
Corrosion Resistance: Per FBC Section 1506.7

**Bearing Plate:**

Material: Galvanized Steel  
Thickness: 18 gauge  
Yield Strength: 40 ksi min.

**Fastener:**

Type: Pancake-Head Self Drilling Screw  
Size : 1/4" x 8"  
Corrosion Resistance: Per FBC Section 1506.6 and 1507.4.4  
Standard: Per SAE J78-1979

**Seam Adhesive/Sealant:**

Product Name: Bostik 70-05A  
Type: One component, polyurethane adhesive  
Application Size: (1)1/4" - 1/2" bead  
Application Location: along female flange the full length of panel  
(Refer to drawing Page 8)

**Components &  
Materials:  
(by Others)**

**Underlayment:**

Material and application shall be in compliance with FBC Section 1507.1.1 and in accordance with applicable code sections and manufacturer's recommendations.

This evaluation is based on testing with the following underlayment:

Product Name: Englert HT Underlayment  
Type: Self-adhered  
Thickness: 40 mils

**Components & Materials: (by Others) Cont.**

**Insulation: (Optional)**

Type: Rigid Insulation Board  
 Thickness: 4" (max.)  
 Properties:  
 Density: 2.25 pcf (lbs/ft<sup>3</sup>) min.  
 Or Compressive Strength: 20 psi min.

**Insulation Notes:**

- Rigid Insulation shall meet minimum density OR compressive strength.
- Insulation shall comply with FBC Section 1508. When insulation is incorporated, fastener length shall conform to penetrate thru bottom of support a minimum of 3/4".

**Installation:**

**Installation Method:**

(Refer to "TABLE A" below and drawings at the end of this evaluation report.)

- Clip Spacing: **Refer to "TABLE A" Below** (along the length of the panel)
- Two (2) fasteners per Clip
- Rib Interlock: Snap-Lock (Panel ribs shall be fully engaged to form an integral snap-lock.)
- Seam Adhesive: Refer to Table "A" & Drawing Page 8. (Apply along female flange the full length of the panel.)
- Minimum fastener penetration thru bottom of support, 3/4".
- For panel construction at the end of panels, refer to manufacturer's instructions and any site specific design.

TABLE "A" ALLOWABLE LOADS				
	Clip Spacing	#Fasteners per Clip	Seam Adhesive	Design Pressure
<b>METHOD 1</b>	12"	2	Not Required	<b>- 78.75 PSF</b>
<b>METHOD 2</b>	6"	2	Not Required	<b>- 90 PSF</b>
<b>METHOD 3</b>	6"	2	1/4 - 1/2" bead Refer to Dwg Pg 8	<b>-157.5 PSF</b>
Notes:				
• Allowable design pressure(s) for allowable stress design (ASD).				

Install the "Series 2000" roof panel assembly in compliance with the installation method listed in this report and applicable code sections of FBC 6th Edition (2017). The installation method described herein is in accordance with the scope of this evaluation report. Refer to manufacturer's installation instructions as a supplemental guide for attachment.

**Referenced Data:**


1. TAS 125-03 (UL580/UL1897) Uplift Test  
By Architectural Testing, Inc. (FBC Organization ID# TST 1558)  
Report #: B8193.01-109-18-r1, Dated: 10 / 16 / 12
2. Quality Assurance  
Keystone Certifications, Inc. (FBC Organization ID# QUA 1824)  
Englert, Inc. Licensee #420
3. Equivalency of Test Standard Certification  
By James L. Buckner, P.E. @ CBUCK Engineering  
(FBC Organization # ANE 1916)
4. Certification of Independence  
By James L. Buckner, P.E. @ CBUCK Engineering  
(FBC Organization # ANE 1916)

**Installation Method**  
**Englert, Inc.**  
**“Series 2000” (0.032” Aluminum) Roof Panel attached to Steel Deck**

Drawings




**Typical Panel Profile**

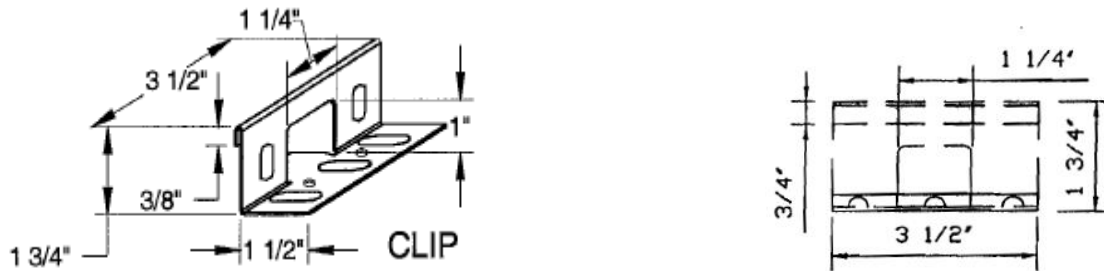

**Panel Clip Profile**  
**Englert “Series 2000 Clip”**  
**(Part # 05076B)**


## Installation Method Englert, Inc. "Series 2000" (0.032" Aluminum) Roof Panel attached to Steel Deck

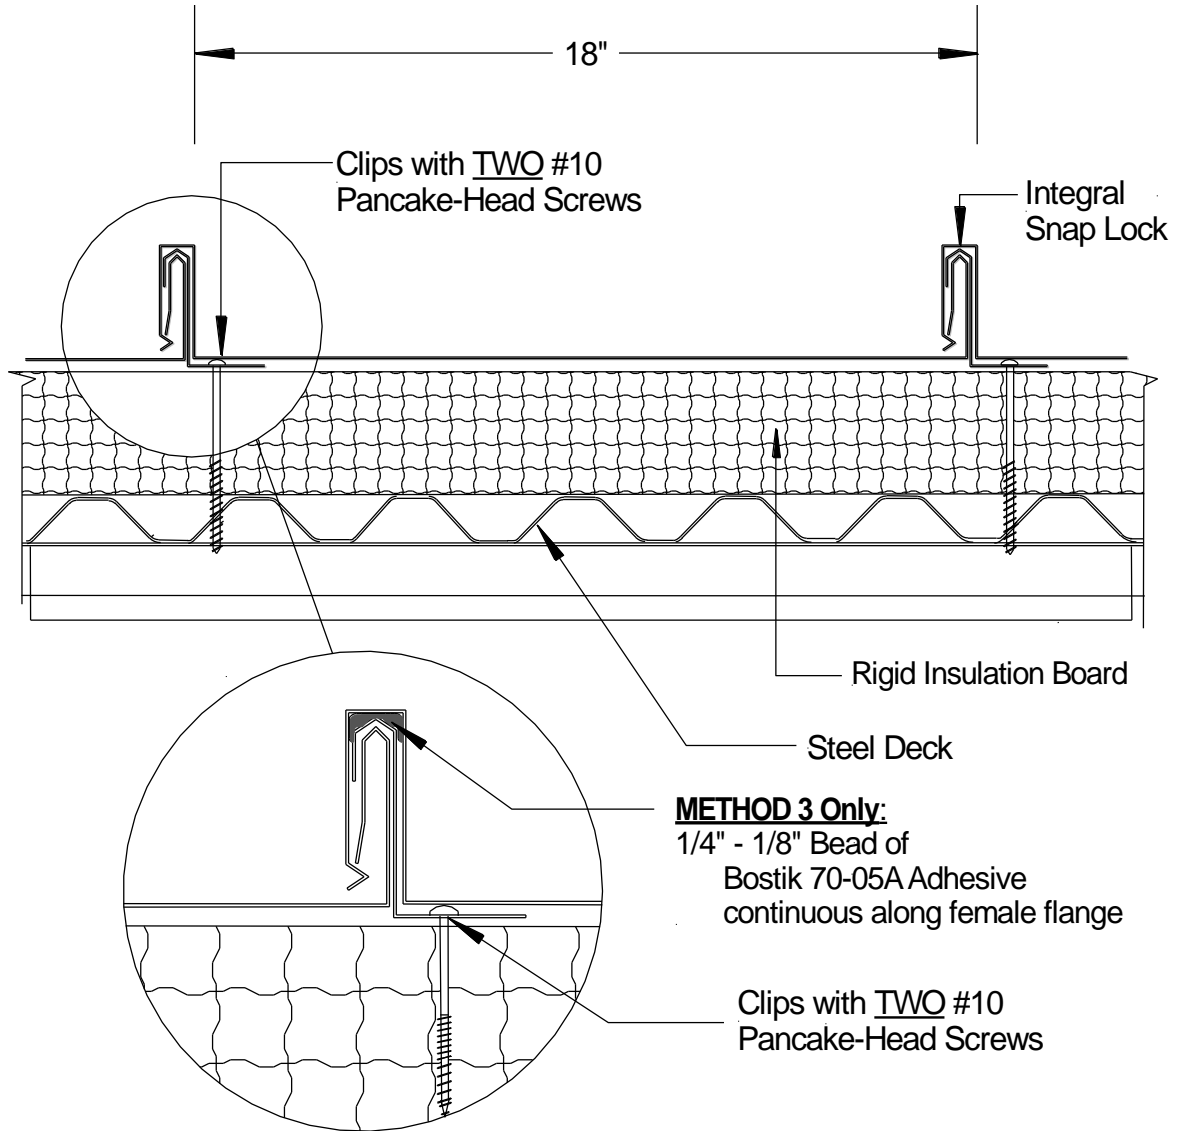

Typical Assembly Profile View  
(Typical Fastening Pattern Across Width)



## Installation Method Englert, Inc. "Series 2000" (0.032" Aluminum) Roof Panel attached to Steel Deck

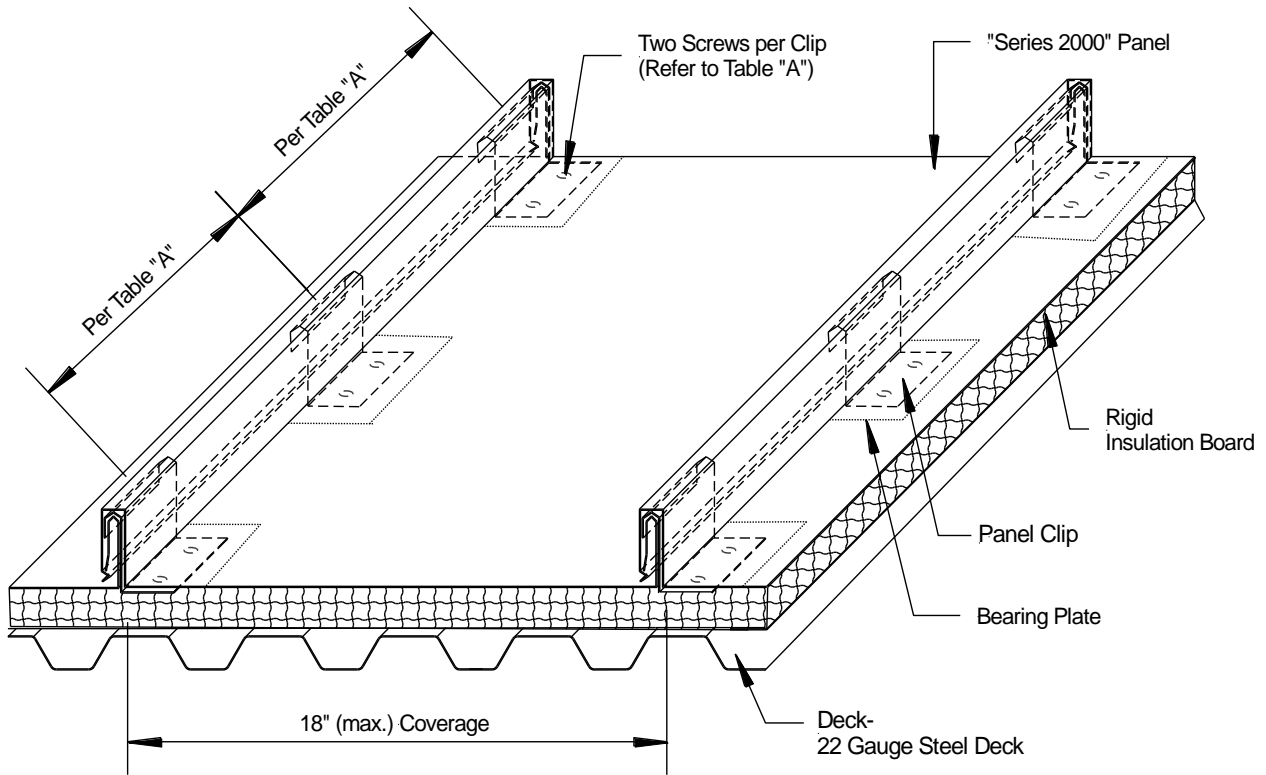

**Typical Roof Assembly  
Isometric View**

<b>TABLE "A"</b>				
	Clip Spacing	#Fasteners per Clip	Seam Adhesive	Design Pressure
<b>METHOD 1</b>	12"	2	Not Required	<b>- 78.75 PSF</b>
<b>METHOD 2</b>	6"	2	Not Required	<b>- 90 PSF</b>
<b>METHOD 3</b>	6"	2	1/4 - 1/2" bead Refer to Dwg Pg 8	<b>-157.5 PSF</b>